




COMMERCIAL PRIVATE WATER SERVICE DETAIL

THE POTABLE / DOMESTIC WATER SERVICE SHALL BE TAPPED INTO THE FIRE SERVICE WITHIN TWENTY-FOUR INCHES (24") OF THE SPRINKLER SYSTEM RPZ VALVE.

(PER 12/27/16 IDPH REQUIREMENT)

(ENFORCED WITH ALL NEW COMMERCIAL BUILDINGS IN WILLOWBROOK AS OF 01/01/2017)

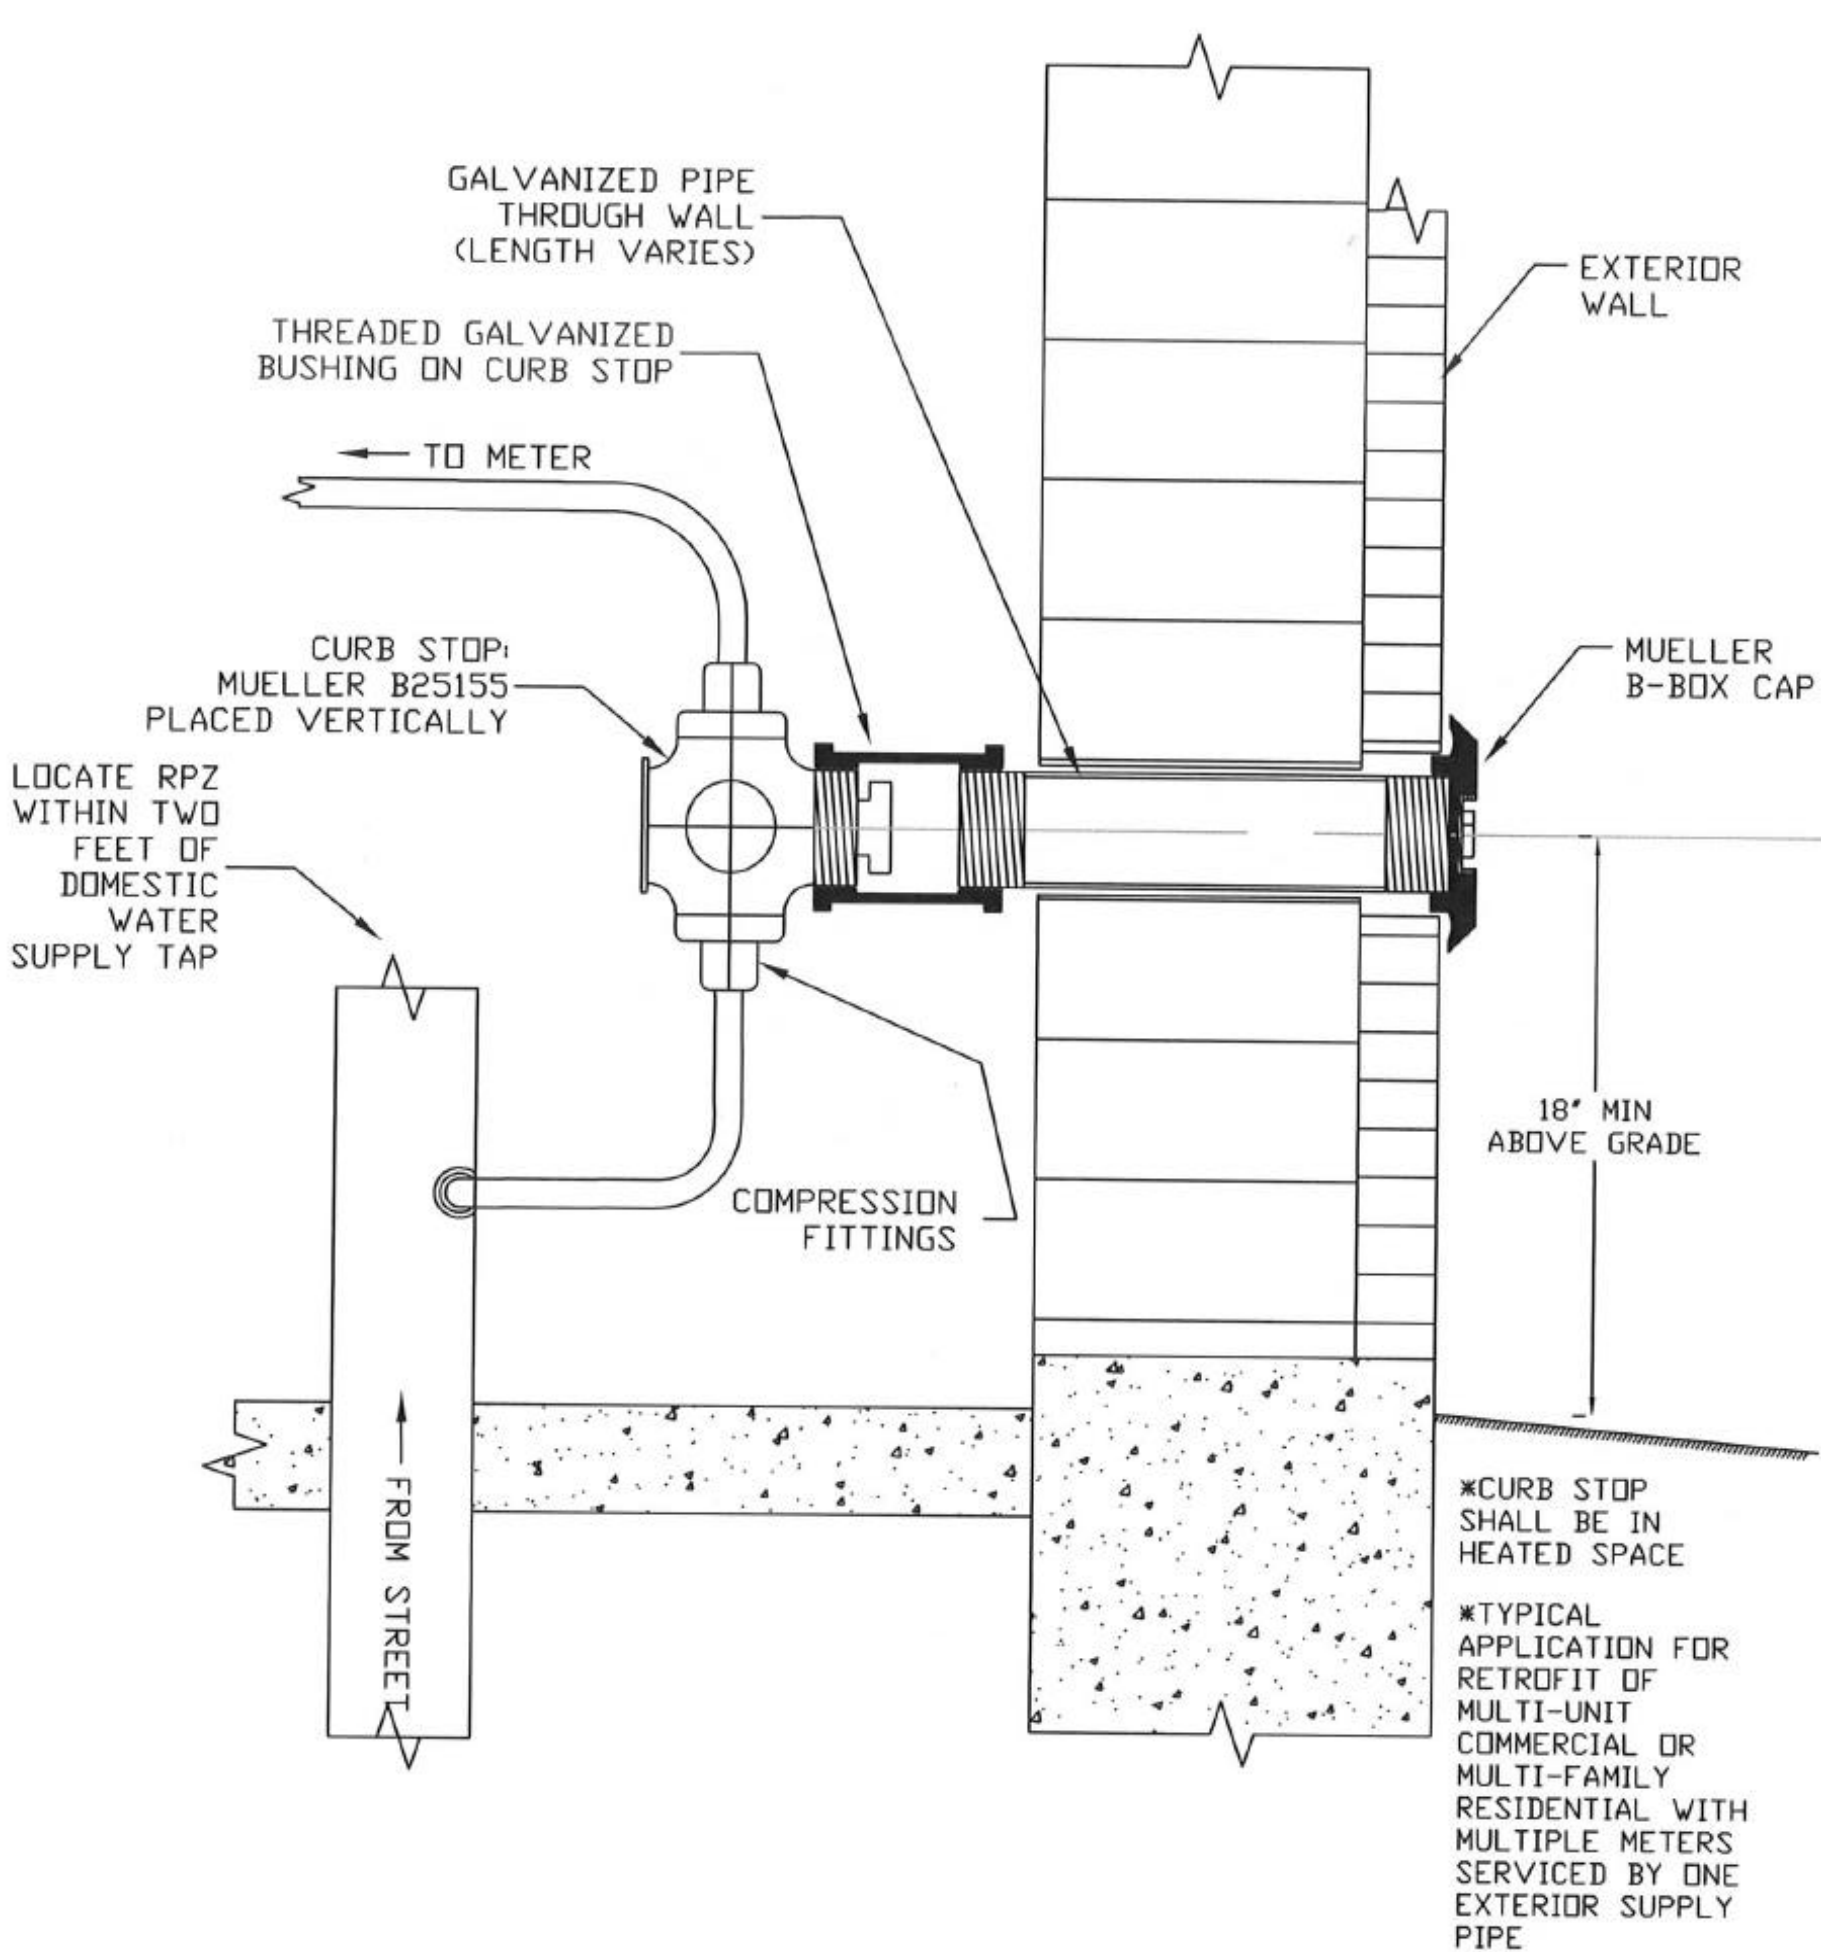

PRIVATE WATER SERVICE
SHUT OFF IN WALL DETAIL

01/18/13 KRL
09/09/16 RFP

N.T.S.